

# FOOD SERVICE TECHNOLOGY CENTER

PROMOTING ENERGY EFFICIENCY IN FOODSERVICE

1.800.398.3782      12949 Alcosta Blvd      Suite 101      San Ramon      CA      94583

**Pre Rinse Spray Nozzle Test Summary Report**      **FSTC Report #: 501311196**      **Date: 04/19/2013**

D. Kiefreider/ K. Sham

Specifications	
<b>Make</b>	YUHUAN MEISHENG SANITARY WARE CO
<b>Model</b>	M0098SV-142G
<b>Rated Flow Rate @ 60 psi (gpm)</b>	1.42



Test Parameters	
<b>Water Pressure</b>	60 ± 2 psi
<b>Water Temperature</b>	120 ± 4°F

Nozzle #1		
Test	Flow Rate (gpm)	Cleanability (seconds)
1	1.38	13
2	1.39	13
3	1.41	13
<b>Average</b>	<b>1.39</b>	<b>13</b>

Nozzle #2		
Test	Flow Rate (gpm)	Cleanability (seconds)
1	1.44	13
2	1.43	13
3	1.44	12
<b>Average</b>	<b>1.44</b>	<b>13</b>

Nozzle #3		
Test	Flow Rate (gpm)	Cleanability (seconds)
1	1.42	12
2	1.41	13
3	1.43	13
<b>Average</b>	<b>1.42</b>	<b>13</b>

Average Results		
	Water Flow (gpm)	Cleanability (seconds)
Nozzle #1	1.39	13
Nozzle #2	1.44	13
Nozzle #3	1.42	13
<b>Average</b>	<b>1.42</b>	<b>13</b>

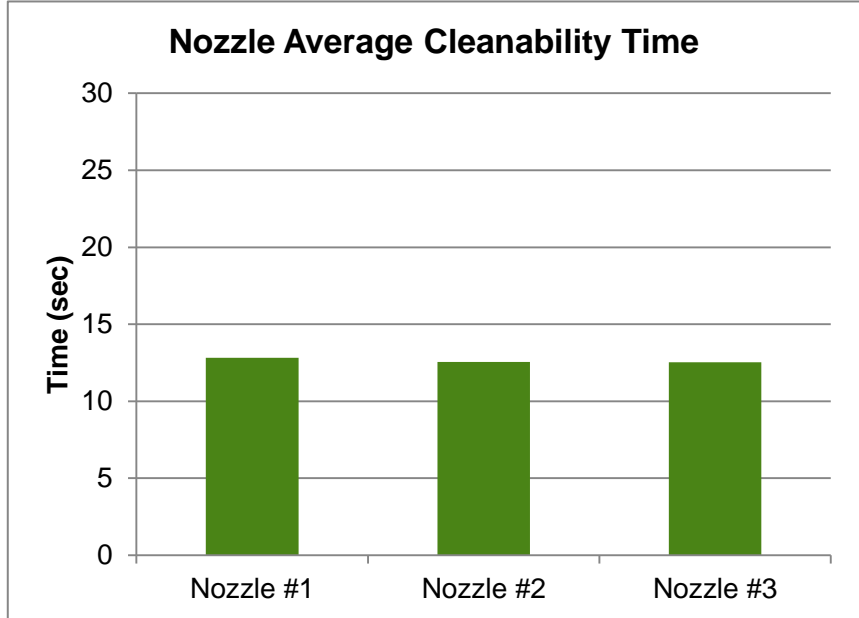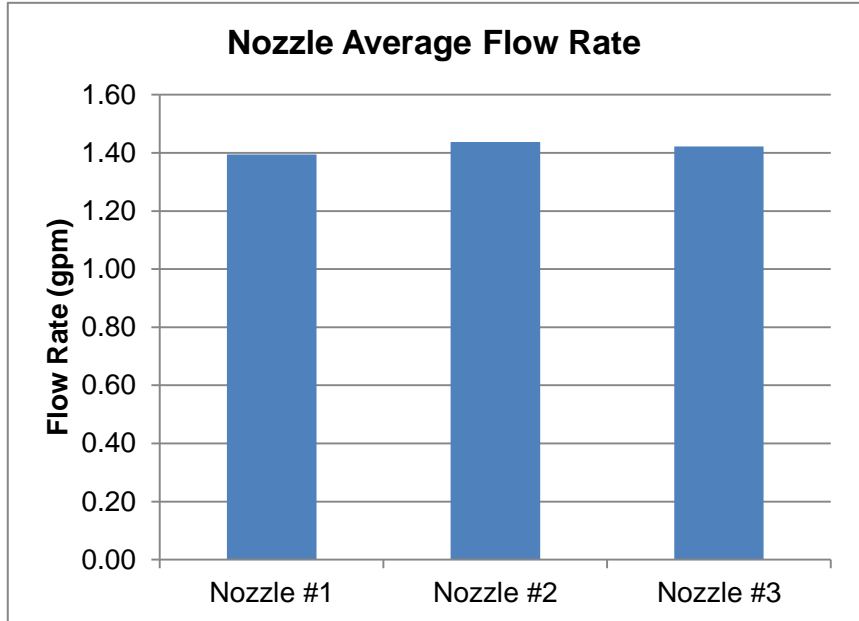

- Tested in accordance with ASTM F2324 - 03 (Standard Test Method for Prerinse Spray Valves)
- Tested nozzles are in compliance with the minimum performance provisions shown in section 1605.3(h) of CA Title 20 Appliance Efficiency Regulation
- Tested nozzles are in compliance with the appropriate marking requirements shown in section 1607 of CA Title 20 Appliance Efficiency

- The Food Service Technology Center program is funded by the California utility customer and administered by the Pacific Gas & Electric Company under the auspices of the California Public Utilities Commission

**Food Service  
Technology Center**

**Addendum: Report Certification**

EPA Organization ID: 1113443


This certifies that the undersigned has performed equipment testing according to the methodology outlined in the report described below, and verifies that the results recorded in that report were the actual results observed.


Report: Yuhuan Meisheng Sanitary Ware Co. M0098SV-142G PRSV


Report #: 501311196-R0 Date published: May, 2013

File name: 13\_05\_03\_Report#501311196-R0.pdf

Date sent for  
authorization: 05/03/2013

Tested by:  Date signed: 05/06/2013  
(signature)  
Kong Sham Research Engineer  
(print name) (title)

FNI  
Authorization:  Date signed: 5/6/2013  
(signature)  
David Zabrowski Director of Engineering  
(print name) (title)

PG&E  
Authorization:  Date signed: 5/6/13  
(signature)  
Charlene Spoor Senior Program Engineer  
(print name) (title)